

## CERTIFICATE OF CONSTANCY OF PERFORMANCE

Issued by DBI Certification, notified body No. 2531.

In compliance with *Regulation 305/2011/EU of the European Parliament and of the Council of 9 March 2011* (the Construction Products Regulation or CPR), this certificate applies to the construction product

**45681-709 XP95 Visual Alarm Device Base (White) with Isolator**

The product fulfils the essential characteristic:

**See Annex 1**

Intended use: Applications related to automatic fire alarm systems

Placed on the market under the name or trade mark of:

**Apollo Fire Detectors Ltd.  
36 Brookside Road  
Havant, Hampshire, P09 1JR  
United Kingdom**

and produced in the manufacturing plant:

**Apollo Fire Detectors Ltd.  
36 Brookside Road  
Havant, Hampshire, P09 1JR  
United Kingdom**

This attests that all provisions concerning the performance described in Annex ZA of the standard(s)

**EN 54-17:2005/AC:2007** : **Fire detection and fire alarm systems - Part 17: Short-circuit isolators**  
**EN 54-23:2010** : **Fire detection and fire alarm systems - Part 23: Fire alarm devices - Visual alarm devices**

under system 1 for the performance set out in this certificate are applied and that the factory production control conducted by the manufacturer is assessed to ensure the

### CONSTANCY OF PERFORMANCE OF THE CONSTRUCTION PRODUCT.

This certificate was first issued on 2019-11-28 and will remain valid as long as neither the harmonised standard, the construction product, the AVCP methods nor the manufacturing conditions in the plant are modified significantly, unless suspended or withdrawn by the notified product certification body.

The attached annexes form part of this certificate.

Date of issue: **2023-10-26**

(This certificate supersedes the previous version of this certificate issued 2021-10-05)



Chris Ellis  
Responsible for evaluation




Steen Nilsson  
Responsible for certification decision

Annex 1

**EXTENT**

<p><b>Type:</b> 45681-709 XP95 Visual Alarm Device Base (White) with Isolator</p> <p><b>Notes:</b></p> <ol style="list-style-type: none"> <li>The VAD is rated as open class: (Refer to installation guide).</li> <li>The VAD operating voltage range 17-28V DC (24V nominal).</li> <li>The VAD Light mode (light pattern details): 0.5Hz mode only.</li> <li>The VAD includes a short circuit isolator.</li> <li>The VAD is a Type A device and includes synchronisation.</li> </ol> <p><b>Accessories:</b> 45681-292 White Cap (Lockable) 45681-293 Red Cap (Lockable)</p> <p><b>Performance</b></p>			
Essential characteristics	Clauses in EN 54-17:2005	Performance	
Performance under fire conditions	5.2 1)	Pass	
Operational reliability	4	Pass	
Durability of operational reliability; temperature resistance	5.4, 5.5	Pass	
Durability of operational reliability; vibration resistance	5.9 to 5.12	Pass	
Durability of operational reliability; humidity resistance	5.6, 5.7	Pass	
Durability of operational reliability; corrosion resistance	5.8	Pass	
Durability of operational reliability; electrical stability	5.3, 5.13	Pass	
<p>1) This is assuming that the effect of the fire is to cause a short circuit in the transmission path that is protected by these devices</p>			
Essential characteristics	Clauses in EN 54-23:2010	Level(s) or class(es)	Notes
Operational reliability: Duration of operation Provision for external conductors Flammability of materials Enclosure protection Access Manufacturer's adjustments On-site adjustment of behaviour Requirements for software controlled devices	4.2.1 4.2.2 4.2.3 4.2.4 4.2.5 4.2.6 4.2.7 4.2.8	None	Pass Pass Pass Pass Pass Pass Pass Pass
Performance parameters under fire condition: Coverage volume Variation of light output Minimum and maximum light intensity Light colour Light temporal pattern and frequency of flashing Marking and data Synchronization (option with requirements)	4.3.1 4.3.2 4.3.3 4.3.4 4.3.5 4.3.6 4.3.7		Pass Pass Pass Red/White Pass/Hz Pass Pass

Durability:			
Temperature resistance:			
Dry heat (operational)	4.4.1.1		Pass
Dry heat (endurance)	4.4.1.2		Pass
Cold (operational)	4.4.1.3		Pass
Humidity resistance:			
Damp heat, cyclic (operational)	4.4.2.1		Pass
Damp heat, steady state (endurance)	4.4.2.2		Pass
Damp heat, cyclic (endurance)	4.4.2.3		Pass
Shock and vibration resistance:			
Shock (operational)	4.4.3.1		Pass
Impact (operational)	4.4.3.2		Pass
Vibration (operational)	4.4.3.3		Pass
Vibration (endurance)	4.4.3.4		Pass
Corrosion resistance:			
SO2 corrosion (endurance)	4.4.4		Pass
Electrical stability:			
EMC, immunity (operational)	4.4.5		Pass

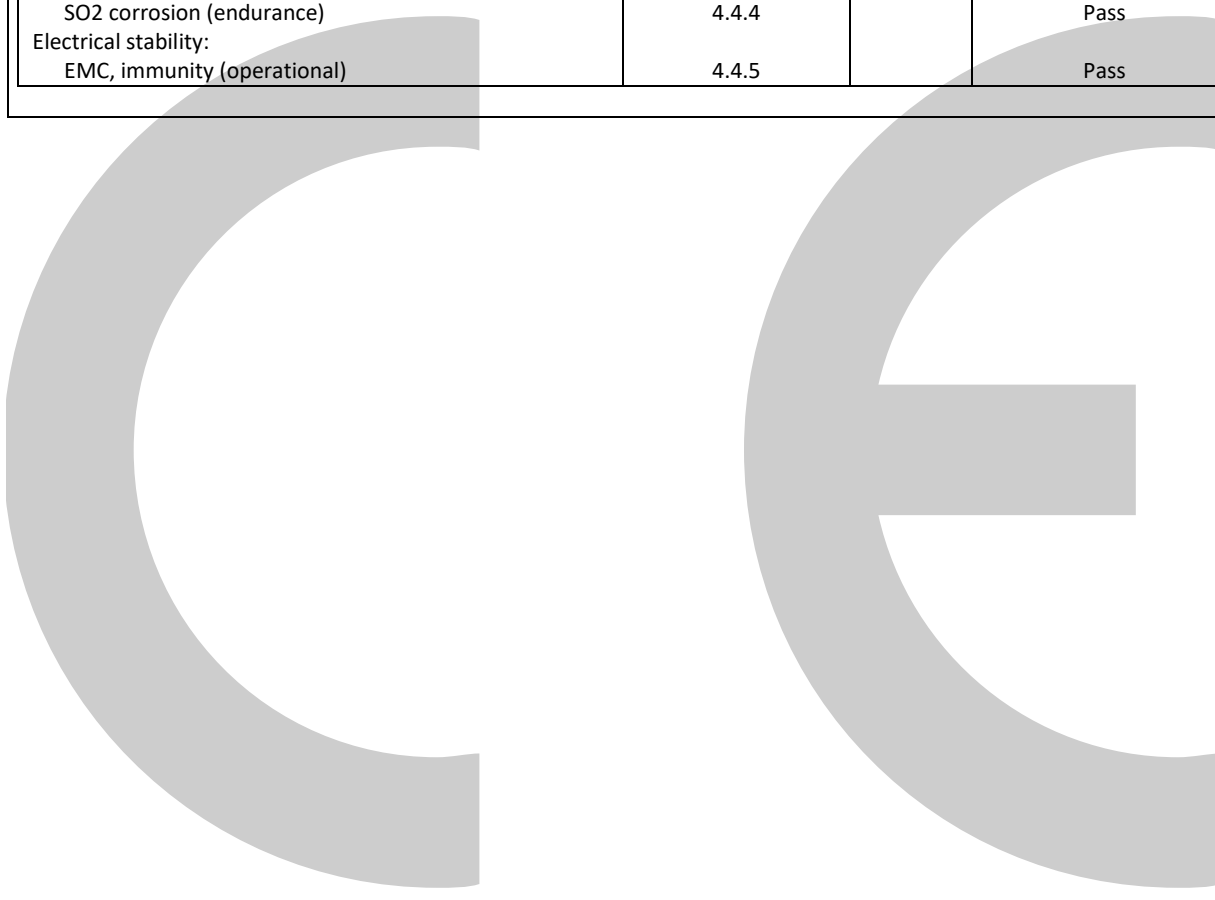

Annex 2

**TEST DOCUMENTATION**

Accredited Laboratory	Report no.	Date
BRE	TE 286206 Revision 1	2014-01-09
BRE	TE 281812 Revision 2	2015-09-24
BRE	TE 286206	2013-12-10
BRE	TE 281812 Revision 1	2014-01-09
BRE	TE-P118556-1000 Revision 1	2021-05-06
BRE	P118556/1.1	2020-05-21
BRE	TE-P110938-1001 Issue: 1	2019-03-25

**TECHNICAL BASIS**

File Number	Title
45681-709	Build Standard